DRAFT - CONFIDENTIAL

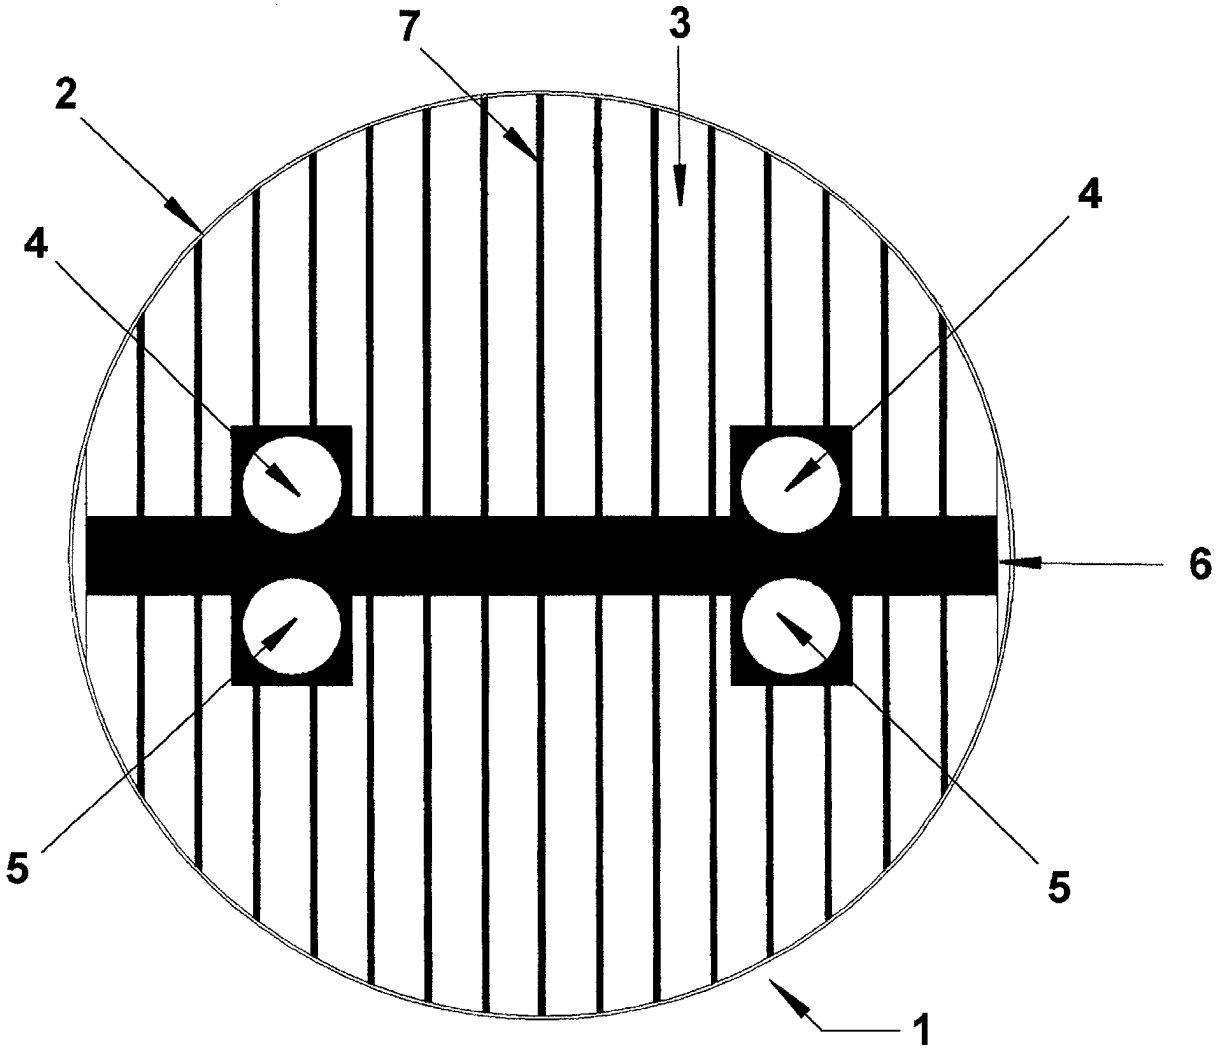

Figure 1

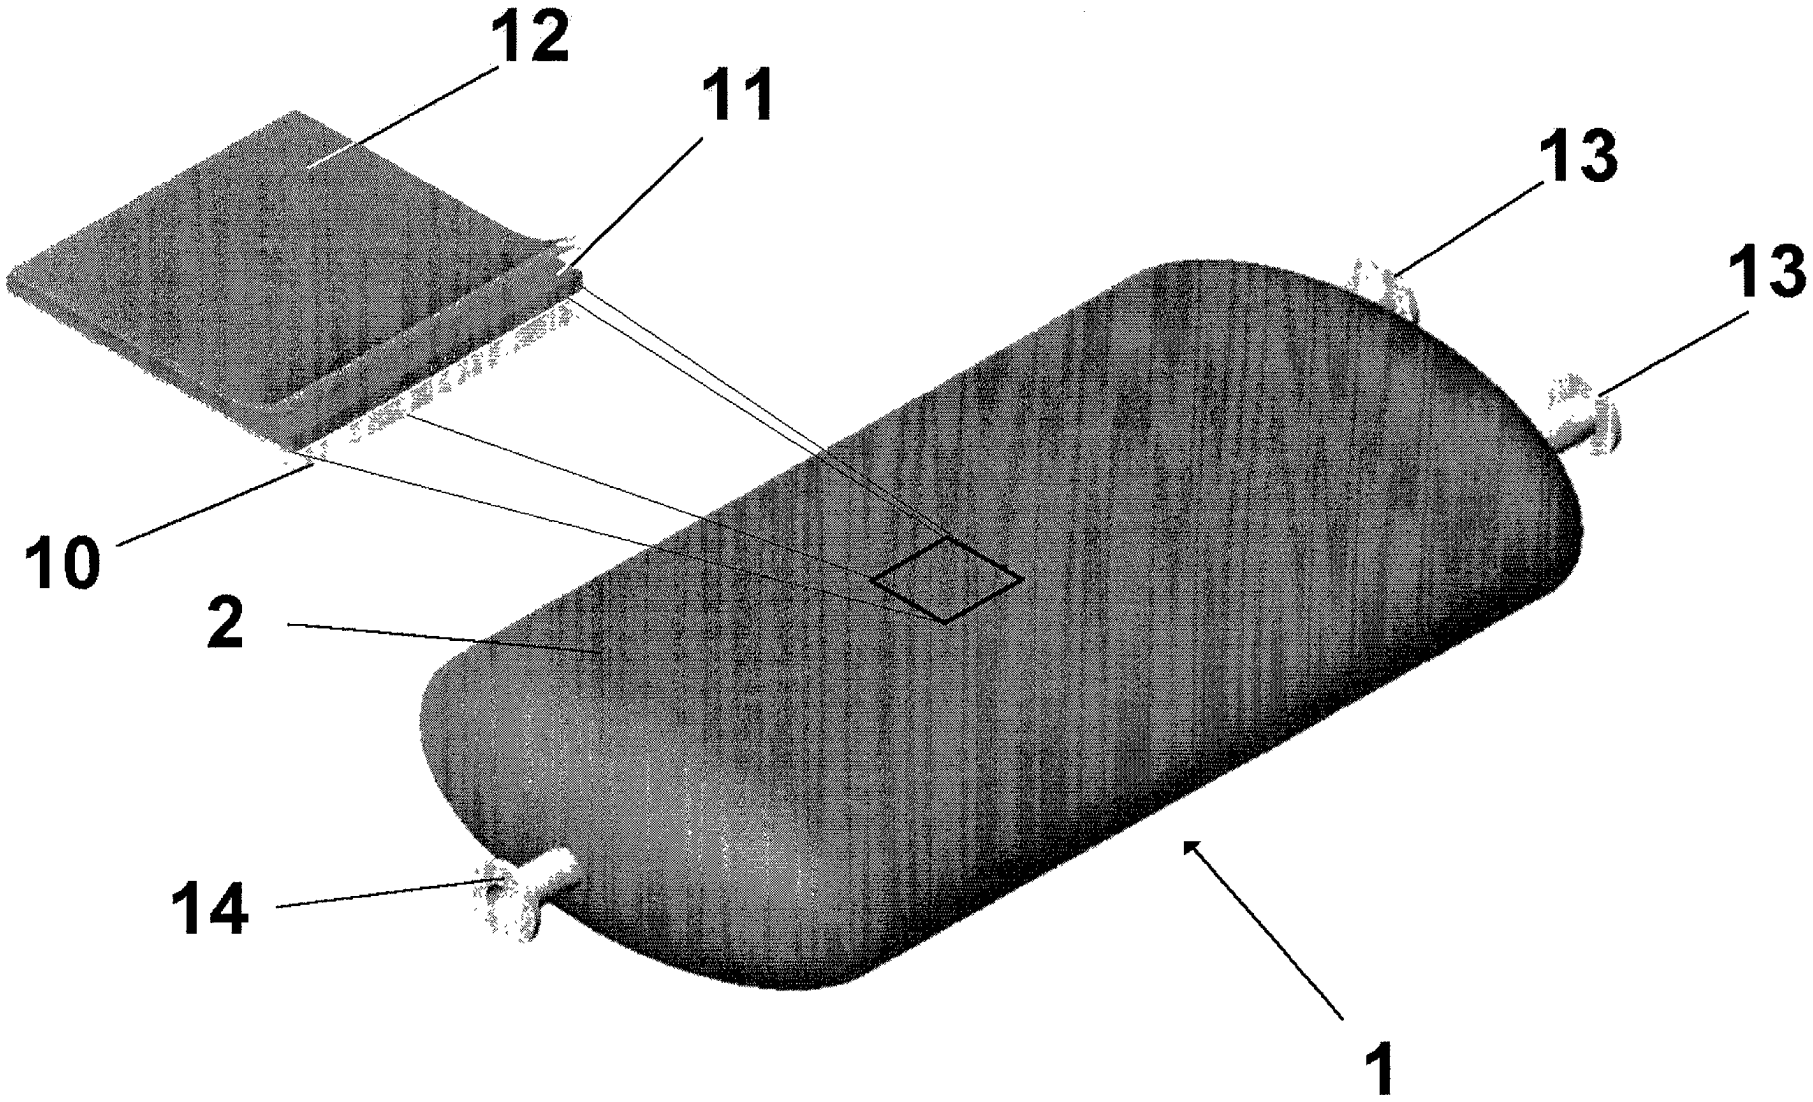

Figure 2

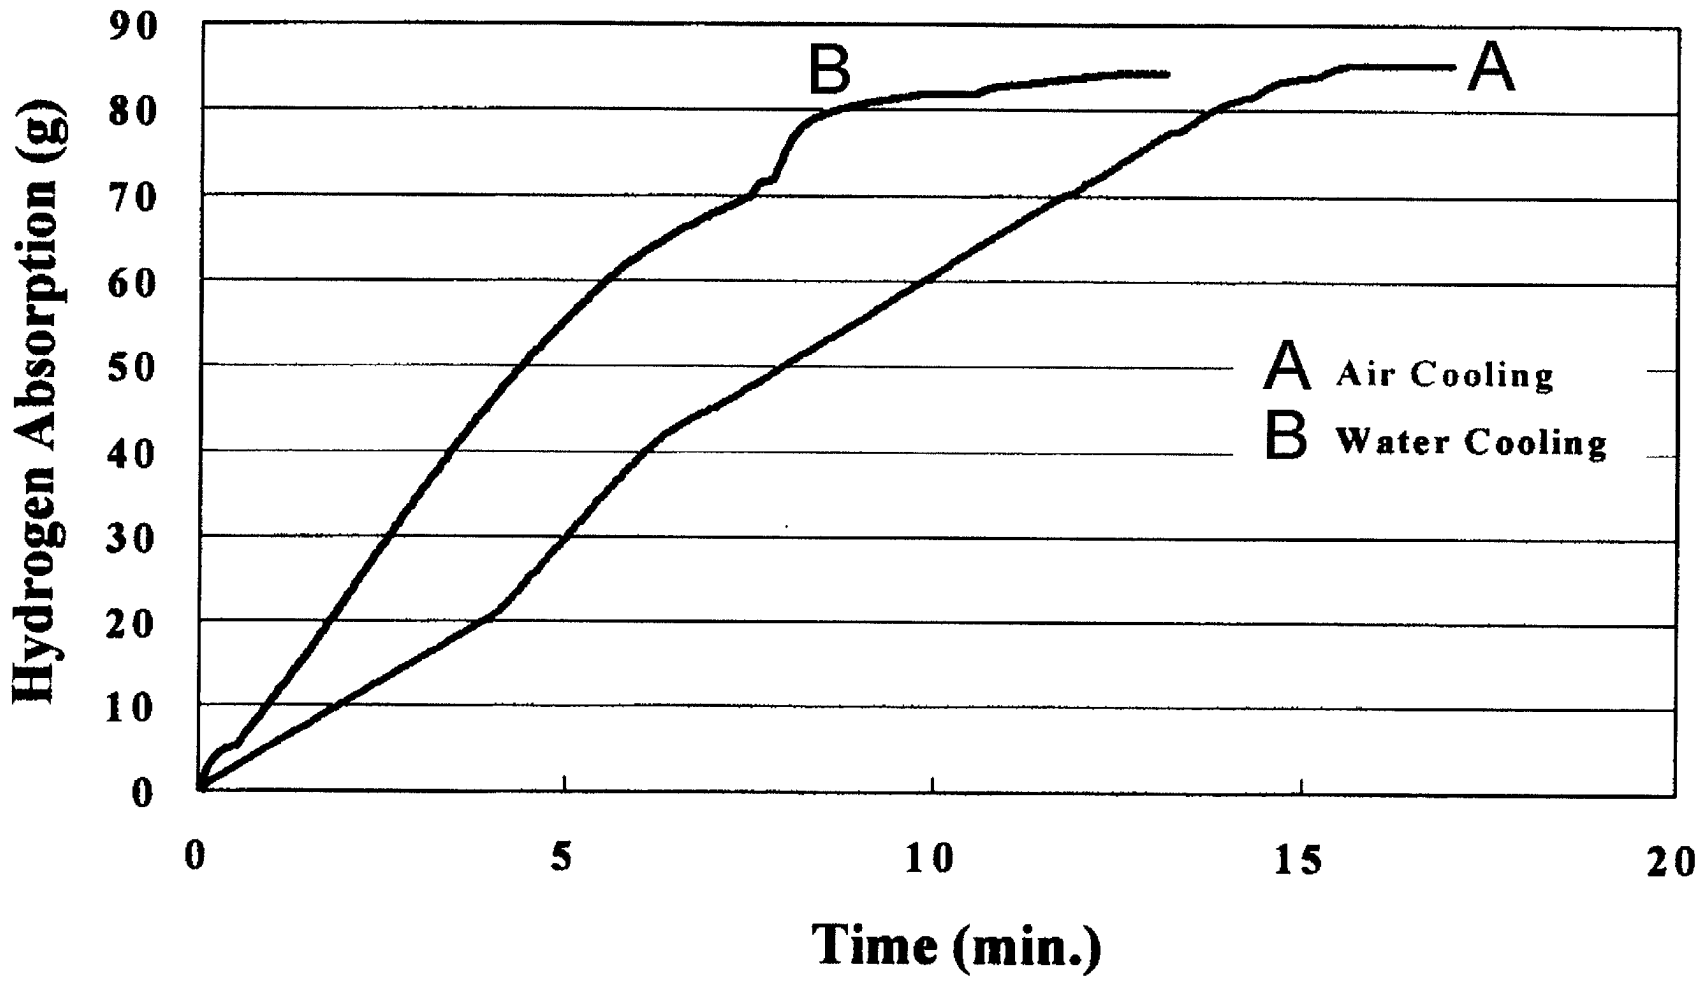
Hydrogen Absorption (g)
90
80
70
60
50
40
30
20
10
0
0
5
10
15
20
Time (min.)
B
A
A Air Cooling
B Water Cooling

Figure 3

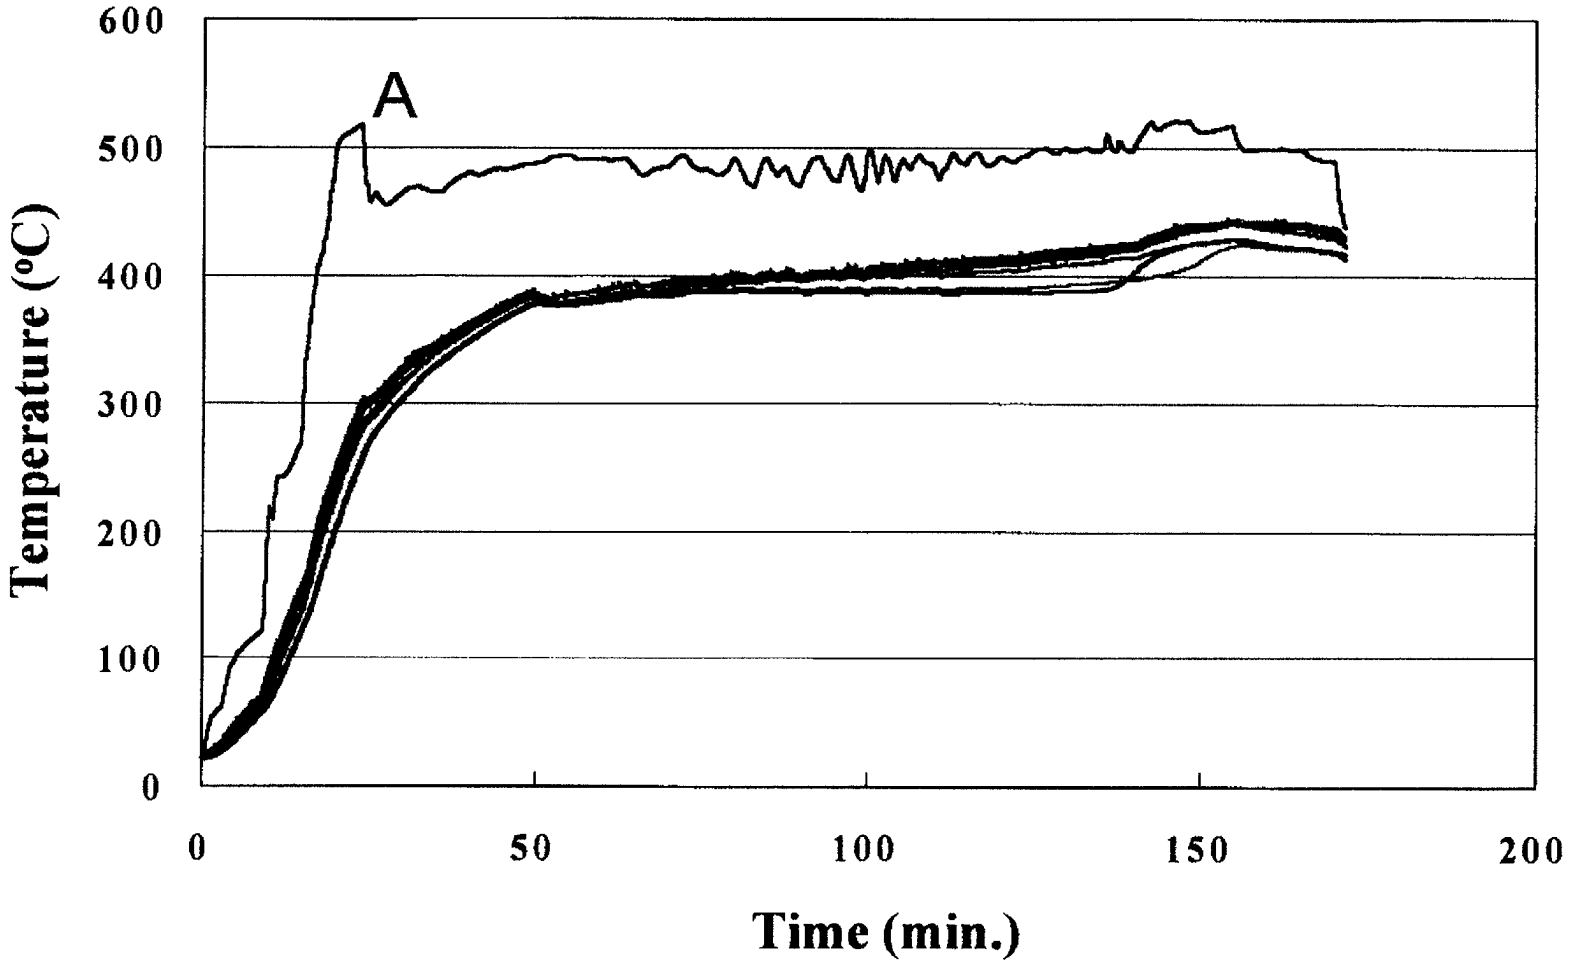
600
500
400
300
200
100
0
A
Temperature (°C)
0
50
100
150
200
Time (min.)

Figure 4

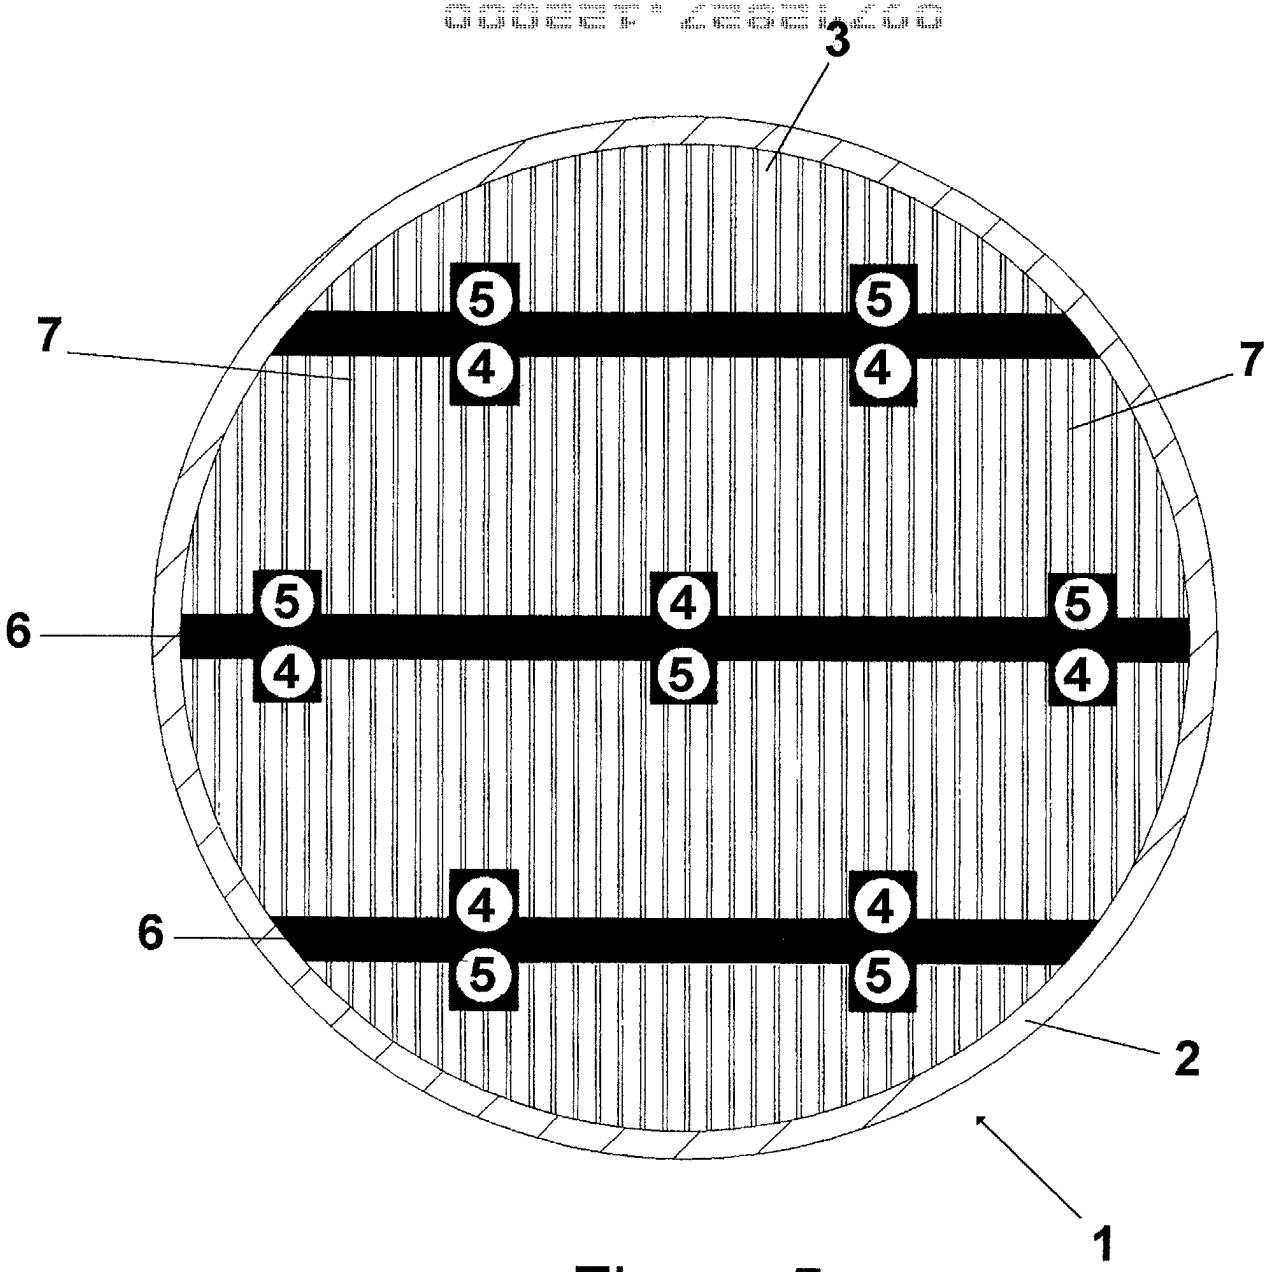

Figure 5

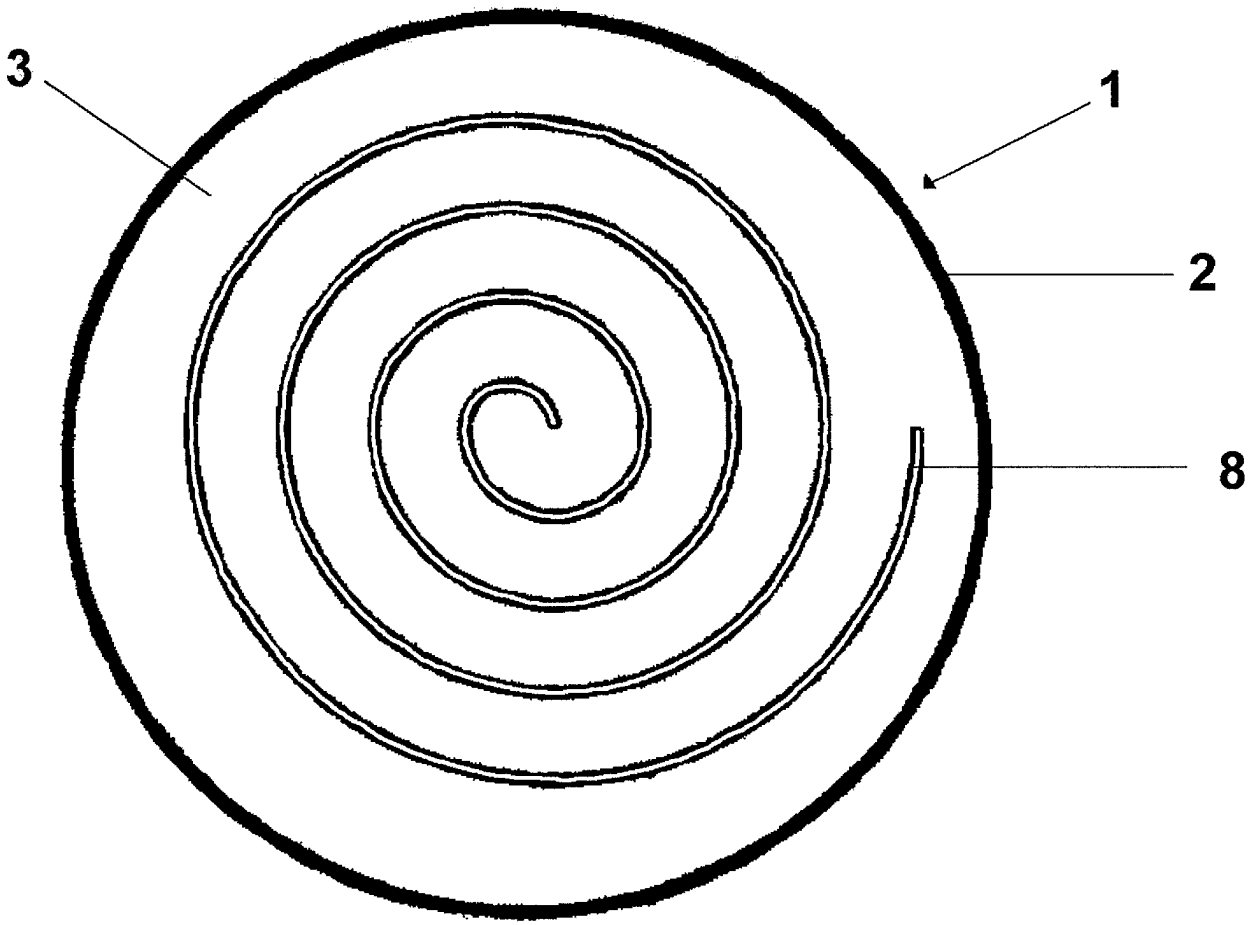

Figure 6

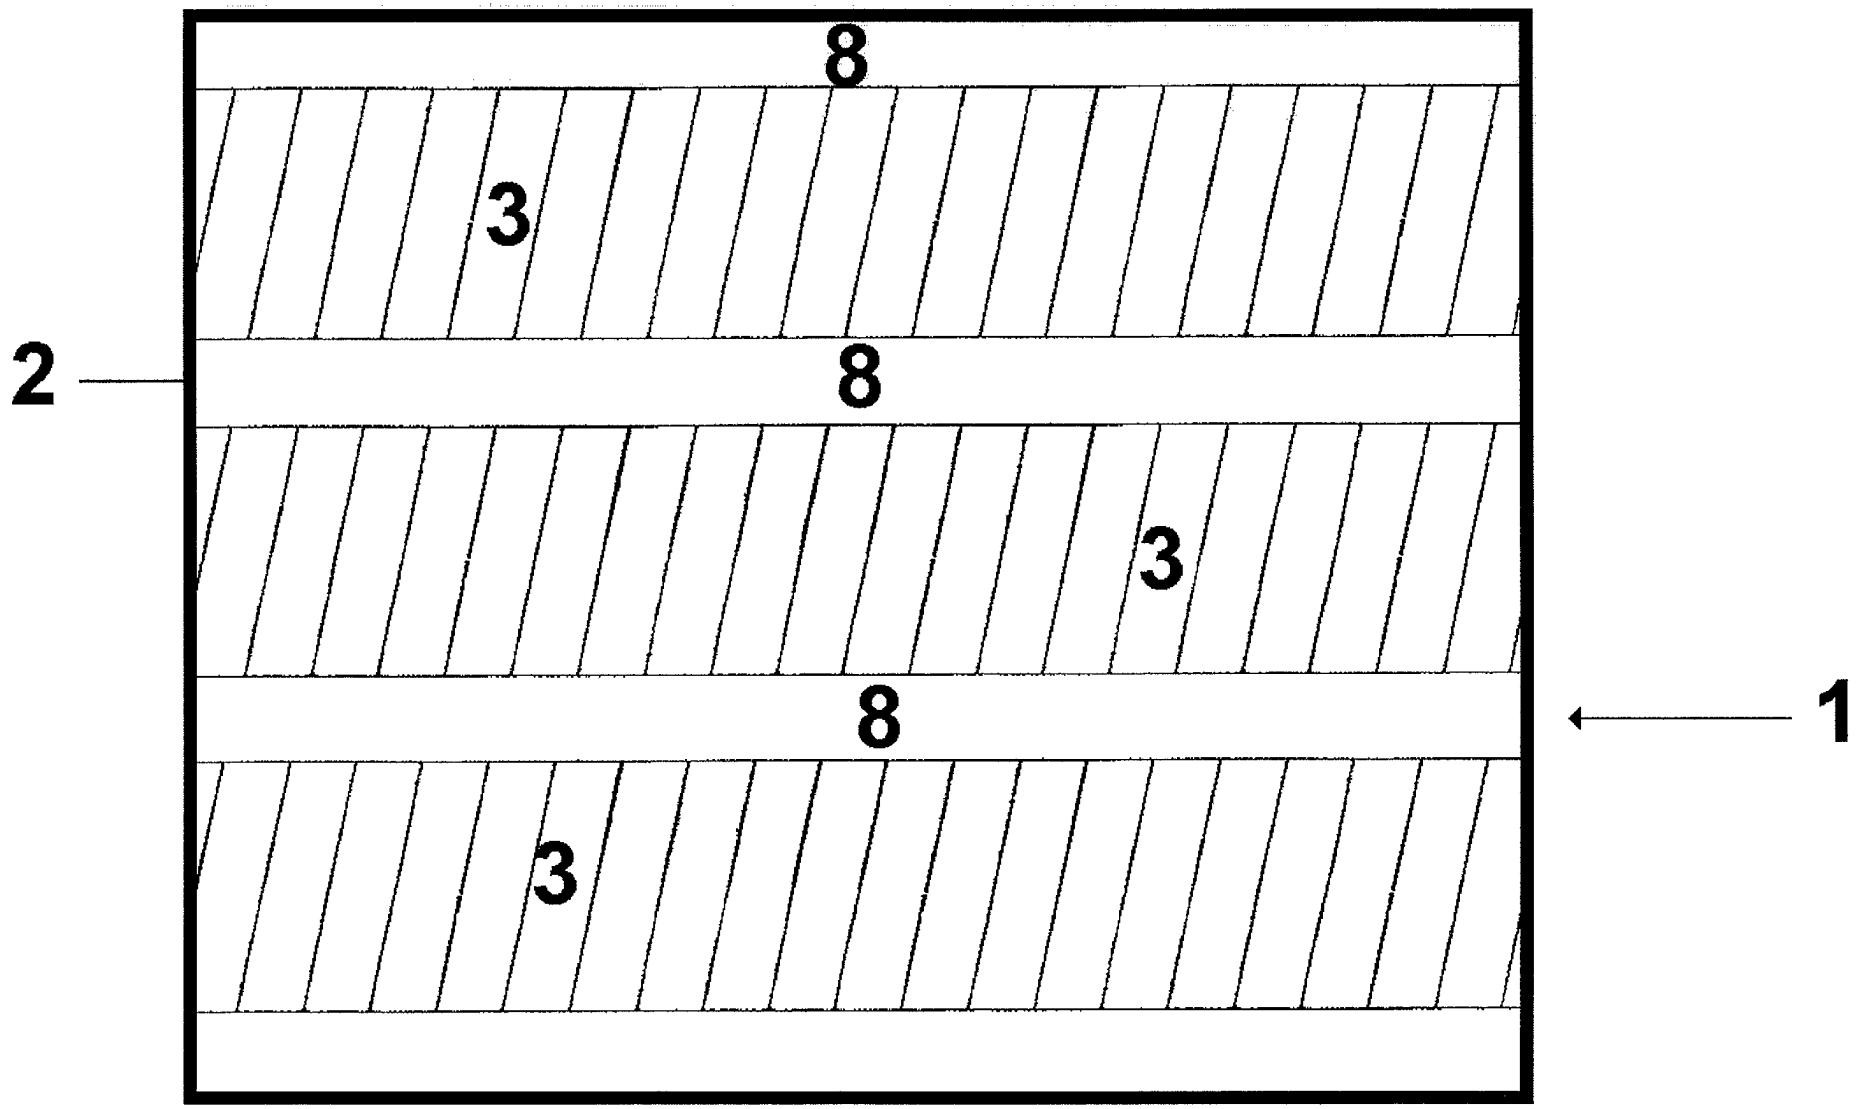

Figure 7

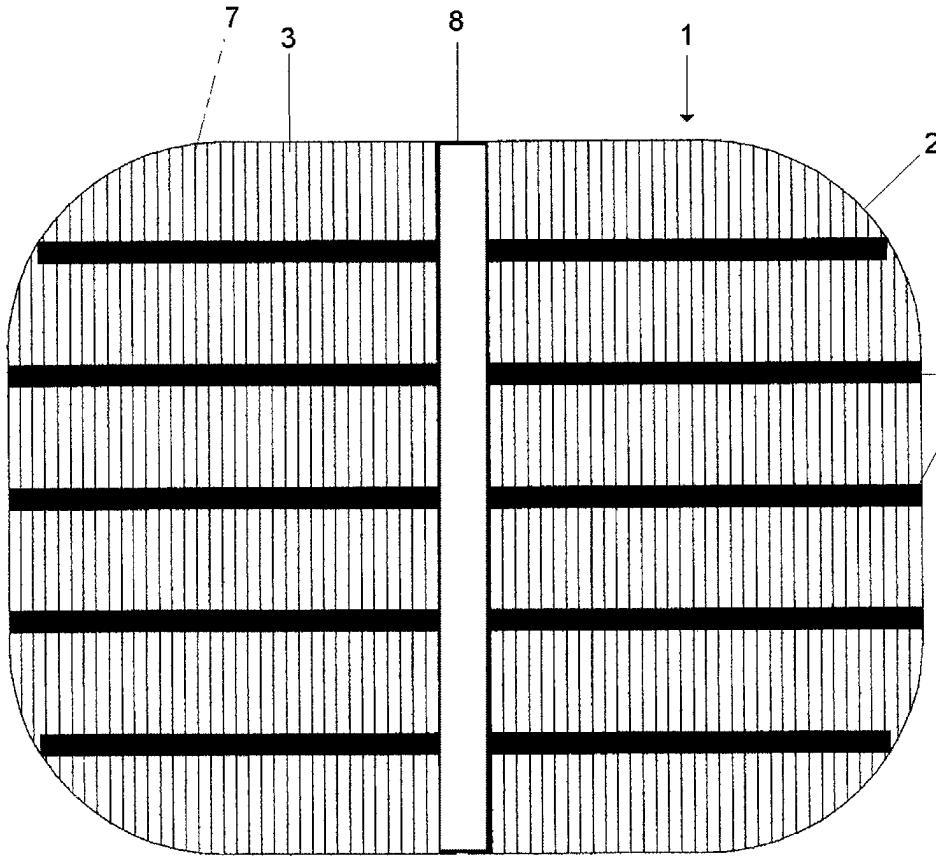

Figure 8a

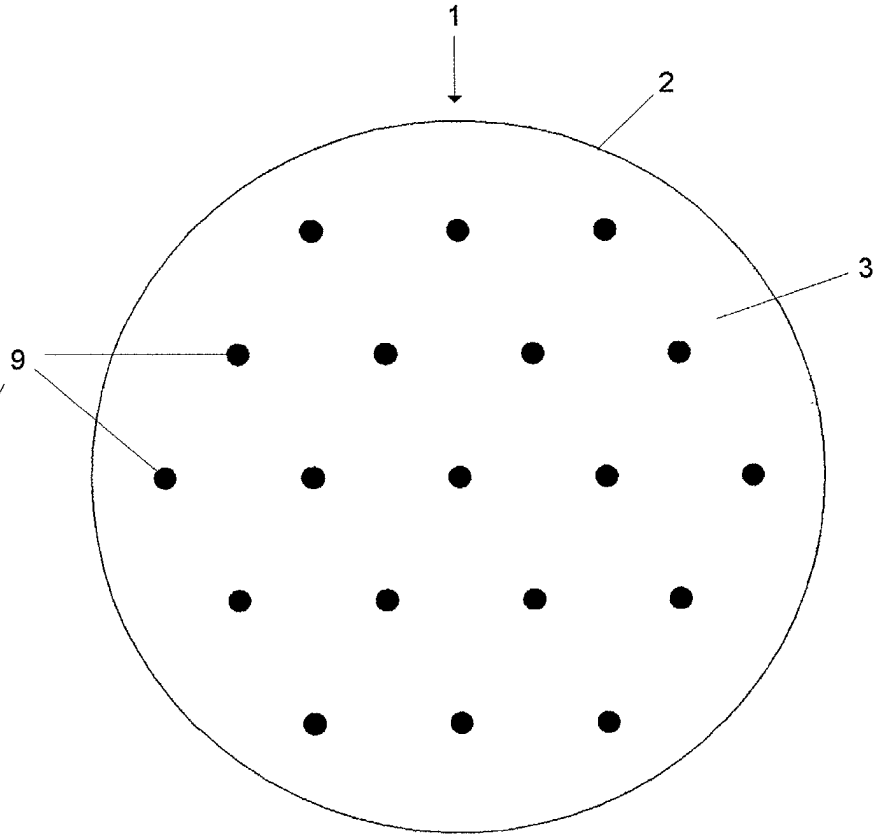

Figure 8b

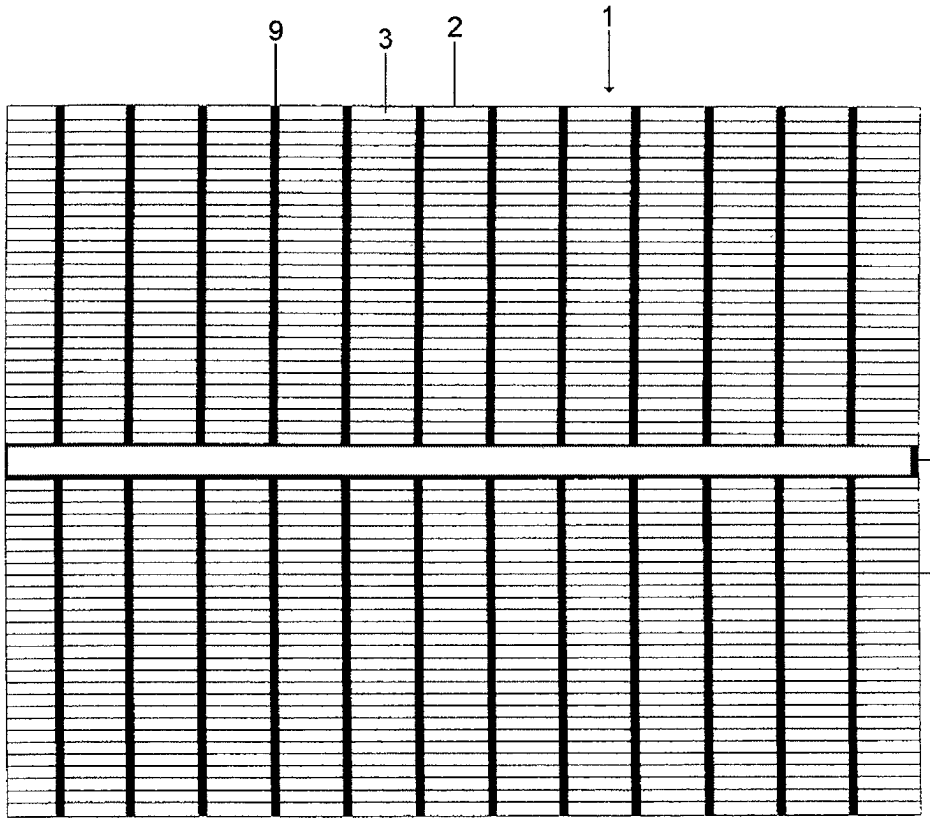

Figure 9a

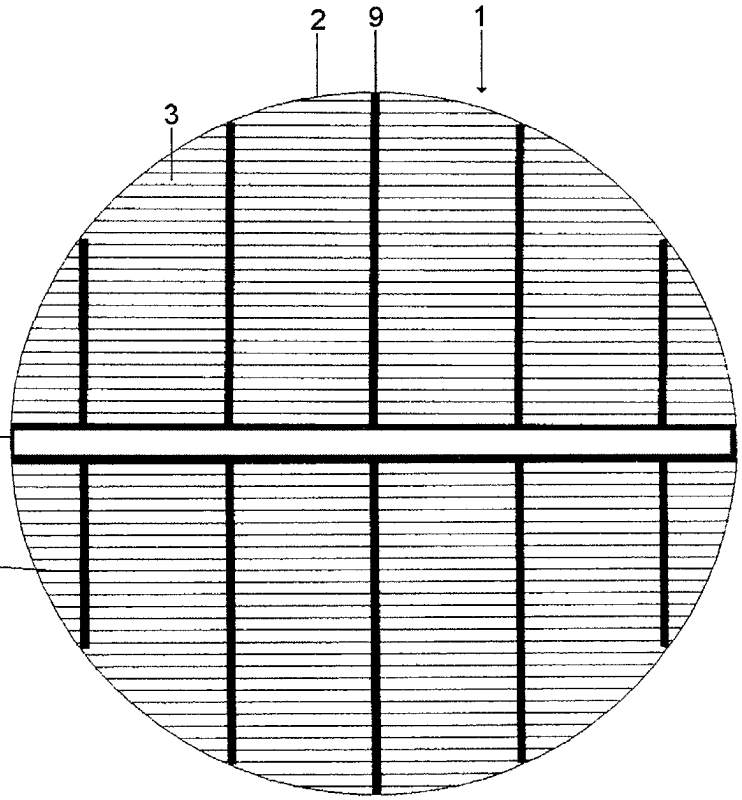

Figure 9b